



Ballast Rack Option Kit

Installation Instructions



View Guide

NOTICE

The information in this publication is subject to change without notice.

COMPAQ COMPUTER CORPORATION SHALL BE LIABLE FOR NO TECHNICAL OR EDITORIAL ERRORS OR OMISSIONS CONTAINED HEREIN, NOR FOR INCIDENTAL OR CONSEQUENTIAL DAMAGES ARISING FROM THE FURNISHING, PERFORMANCE, OR USE OF THIS MATERIAL. THIS INFORMATION IS PROVIDED AS IS. COMPAQ COMPUTER CORPORATION DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO WARRANTIES OF MERCHANTABILITY, FITNESS FOR PARTICULAR PURPOSES, GOOD TITLE AND AGAINST INFRINGEMENT.

This publication contains information protected by copyright. No part of this publication may be photocopied or reproduced in any form without prior written consent from Compaq Computer Corporation.

© 1999 Compaq Computer Corporation
All rights reserved. Printed in the U.S.A.

Compaq, Registered Use and Trademark Office.

Ballast Rack Option Kit

First Edition (December 1999)

Part Number 002559-

Compaq Computer Corporation



142559-001

About This Device

This option is for use with Compaq 9142 or 9136 single rack installations to provide additional stability.

Kit Contents

- Ballast assembly (2)
- 5.5 mm self-tapping screws (10)

Additional Equipment

You will also need a Phillips screwdriver.

Rack Considerations

Before beginning these procedures, make sure you understand and follow these precautions:



WARNING: To reduce the risk of personal injury or damage to the equipment, be sure that:

The leveling jacks are extended to the floor.

The full weight of the rack rests on the leveling jacks.

The stabilizing feet are attached to the rack, if it is a single-rack installation.

The racks are coupled in multiple-rack installations.

Only one component is extended at a time. (A rack may become unstable if more than one component is extended for any reason.)



20.41 kg
45 lb



WARNING: Under these conditions, the ballast weight exceeds the recommended weight for one individual to handle safely. To reduce the risk of personal injury or damage to the equipment:

Observe local occupational health and safety requirements and guidelines for manual material handling.

Obtain adequate assistance to lift and stabilize the ballast weight during installation and removal.

Installation

 **CAUTION:** To avoid personal injury or damage to the equipment, it is recommended that the Ballast Rack Option Kit only be installed in unconfigured racks.

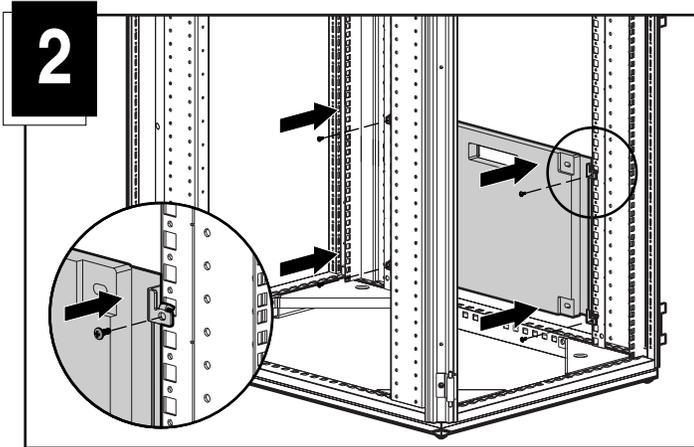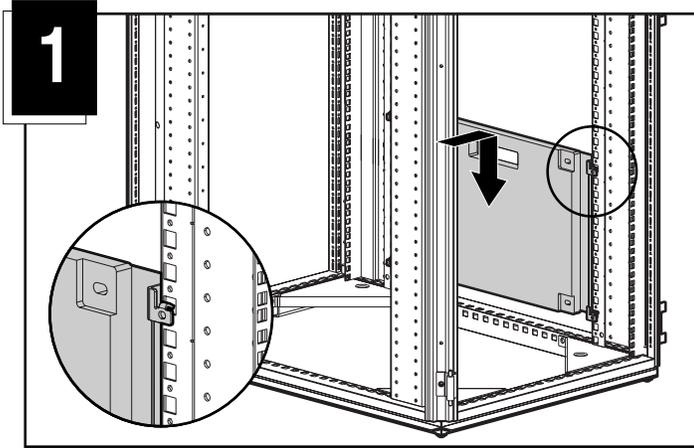

Repeat for the other side.